

CITY OF HOUSTON
HIGH RISE OFFICE BUILDING
FIRE SAFETY PLAN

BROOKHOLLOW CENTRAL I

DATE
May 6, 2014

SENIOR PROPERTY MANAGER
Mary Hoover

ADDRESS
**2800 NORTH LOOP WEST
HOUSTON, TEXAS 77092**

(713) 255-2340

**LIFE SAFETY IS THE GOAL OF THIS PLAN. ALL DUTIES CALLED FOR HEREIN SHOULD
BE DONE FROM A SAFE LOCATION IF POSSIBLE.**

TABLE OF CONTENTS

	PAGE
PROCEDURES FOR REPORTING FIRES AND FIRE ALARMS.....	3
ORGANIZATIONAL CHART	4
EMERGENCY PROCEDURES.....	5
GENERAL DUTIES.....	10
RESPONSIBILITIES.....	11
FIRE DRILLS	14
SPECIAL INSTRUCTIONS ASSISTING THE MOBILITY IMPAIRED	15
PUBLIC ADDRESS ANNOUNCEMENTS	16
FIRE ALARM RECORDING	17
APPENDIX	
I FIRE ALARM SYSTEM OPERATIONS.....	
II BUILDING FIRE SAFETY FEATURES	
III SPECIFIC INSTRUCTIONS FOR ELEVATOR OPERATION	
IV CERTIFIED FIRE WARDENS.....	
V MAPS	

PROCEDURES FOR REPORTING FIRES & FIRE ALARMS

I. NOTIFICATION

A. If The Following Is Reported to you, Or If You See Smoke, Or See Flames, Or Smell Something Burning, Or Hear A Fire Alarm, IMMEDIATELY:

- Call the Fire Department – Dial: **9-1-1**
- Call the Fire Safety Director – Management: Mary Hoover 713-255-2343.
- Activate the Fire Alarm Pull Station - If the Fire Alarm is not sounding.
- Report any change in conditions to the Fire Department and the Fire Safety Director.

B. If You Think You Smell A Peculiar Or Unfamiliar Odor, IMMEDIATELY:

- Call the Fire Safety Director – Management: Mary Hoover 713-255-2343.

C. Information To Be Given To The Fire Department:

- What is the Emergency: (Alarm, Smoke, Flames, Etc.)
- Address: 2800 N. Loop W. (Closest Cross Street) Directors Row.
- Type of Occupancy: (**High-rise Office Building**)
- What Floor: _____, Room # _____, Telephone # calling from _____ .
(Let The Fire Department Hang Up First!)

II. EMERGENCY PROCEDURE PRIORITIES

A. If The Following Is Reported To You, Or If You See Smoke, Or See Flames, Or Smell Something Burning, IMMEDIATELY:

- **Isolate** the fire - (close the door if you can do so safely)
- **Call the Fire Department**, Fire Safety Director, and Activate the Fire Alarm Pull Station, if the Fire Alarm is not sounding.
- **Evacuate** - Using Exit/Stairs to a safe area. Relocation and reentry into the building at least 3 or more levels below the fire floor is generally adequate.
- **Fire Extinguishment** (is optional and only if all of the above has been completed)

B. Emergency procedures - in the event of an alarm only:

- Call the Fire Department and the Fire Safety Director.
- Minimum procedure: Prepare to evacuate by going to the Exit/Stair door, if there is any evidence of unwanted fire, evacuate the floor to a safe area.
- Report any change in conditions to the Fire Department and the Fire Safety Director.

C. Fire Safety Director:

- Call the Fire Department, and have someone meet the Fire Department upon their arrival. Any unwanted fire shall be reported to the Fire Department, no matter how small, even if extinguished.
- Recall all elevators that access the floor of incident by turning the Elevator Fire Service Recall Switch to the “ON” position.
- Direct evacuation procedures utilizing the public address, if available.

FIRE SAFETY TEAM ORGANIZATIONAL CHART

Mary Hoover, Sr. Property Manager
713-255-2343

FIRE SAFETY DIRECTOR

Carlos Gonzalez, Chief Engineer
281-898-1876

ASSISTANT FIRE SAFETY DIRECTOR

BUILDING EMERGENCY RESPONSE PERSONNEL

Security Manager, Jose Martinez
713-683-8671

Chief Engineer, Carlos Gonzalez
281-898-1876

Asst. Chief Engineer, Randy Burleson
281-830-1657

FIRE WARDENS

See page IV

EMERGENCY PROCEDURES

I. FIRE SAFETY DIRECTOR

In the event of an unwanted fire or fire alarm:

- A. **Ensure** that the Fire Department has been notified immediately whenever an unwanted fire of any size occurs and/or fire alarm of any nature.
 - 1. Have someone knowledgeable of the building meet the Fire Department upon their arrival.
 - 2. Advise the Fire Department in the operation of the building's fire and life-safety equipment.
 - 3. Report any known conditions on the fire floor or alarm floor to the Fire Department upon their arrival.
- B. Manning the Fire Command Station.
 - 1. Ascertain the floor in alarm and report any additional alarms to the Fire Department.
 - 2. Ensure that all elevators serving the floor of incident are removed from service from the general public and made available to the Fire Department and Building Emergency Response Personnel (if so trained and authorized). Specific operating instructions will depend on the individual building. The specific instructions for this building are located in Appendix III and the Fire Depository Box.
 - 3. Direct evacuation procedures utilizing the public address, if available.
 - a) Be familiar with the location of all Exits/Stairs and select the safest Exit/Stair to use for evacuation on the basis of the location of the fire and any information available. If affected by smoke, an alternate Exit/Stair shall be selected.
 - b) The priority floors for immediate evacuation are the fire floor, one floor above and one floor below the fire. Relocation and reentry into the building at least 3 or more levels below the fire floor is generally adequate.
 - c) Evacuation from other floors shall be instituted when conditions indicate such action or when instructed by the Fire Department or the Fire Safety Director. Evacuation should be via uncontaminated Exit/Stairs.
 - d) Relocation and reentry into the building at least 3 or more levels below the fire floor is generally adequate.

- e) Mobility-Impaired occupants may require special assistance in the event of a fire. Occupants not requiring assistance should evacuate first. This avoids the possibility of persons in need of assistance being bumped and/or falling down, thus slowing evacuation and/or causing injury. If there is evidence of fire, the person having mobility impairments should be positioned near the Exit/Stair that is located farthest away from the fire. If fire conditions pose personal threat, the person having mobility impairment, Fire Warden or any other person assisting, should be positioned within the Exit/Stair and wait for the Fire Department. If fire conditions pose a personal threat in the Exit/Stairs, the mobility-impaired person should be evacuated to a safe location. If the mobility impaired person enters the Exit/Stairs, someone should notify the Fire Department of their location in the Exit/Stairs and that the mobility impaired person requires special assistance with evacuating.

II. ASSISTANT FIRE SAFETY DIRECTOR

In the event of an unwanted fire or fire alarm:

- A. Assist the Fire Safety Director to ensure the effective implementation of the Fire Safety Plan.
- B. In the absence of the Fire Safety Director, assume the full duties and the responsibilities of that position.

III. BUILDING EMERGENCY RESPONSE PERSONNEL

- A. Assume the job of the Fire Safety Director or Assistant Fire Safety Director in absence of either person.
- B. When there is a Fire Safety Director and Assistant Fire Safety Director on duty in the building:
 - 1. Ascertain the floor in alarm.
 - 2. **If any evidence of fire has already been reported or confirmed, do not respond to the floor.**
 - a) Assist the Fire Safety Director.
 - 3. **May** respond to the floor in alarm using Exit/Stairs to determine the cause of the alarm.
 - 4. The use of elevators when the building is in alarm is **prohibited** except under guidelines set forth by the Fire Marshal.
 - 5. After responding to the floor in alarm, if fire is confirmed, and when it can be done safely, may assist in evacuating occupants on the affected floor.

6. Report fire floor conditions from a safe location to the Fire Department, by calling **9-1-1**, and then to the Fire Safety Director. If fire conditions do pose a personal threat, evacuate to a safe location using the Exit/Stairs.
- C. Return to meet the Fire Department for further instructions via uncontaminated Exit/Stairs.

IV. ANSWERING SERVICE

In cases where a building answering service is made aware of a fire or suspected fire situation in a building they should be instructed to:

- A. Have the caller immediately notify the fire department by dialing 911.
- B. Notify the building Fire Safety Director or some other building emergency contact person of the situation.

The building Fire Safety Director shall ensure that their answering service is provided with up to date emergency contact information at all times.

V. FIRE WARDENS

- A. Each floor of a building shall be under the direction of the Fire Wardens for the evacuation of occupants in the event of an unwanted fire or fire alarm, where applicable.
- B. Each Fire Warden shall be familiar with the Fire Safety Plan, the location of Exits/Stairs and the location of, and how to activate, the fire alarm.
- C. In the event of an unwanted fire or fire alarm the Fire Warden, when it can be done safely, shall:
 1. Notify the Fire Department, as specified in the approved Fire Safety Plan.
 2. When it can be done safely, should see that other occupants are notified of the fire or fire alarm, and should instruct occupants as per the Fire Safety Plan. If fire conditions do pose a personal threat, The Fire Warden should activate the fire alarm pull station and evacuate to a safe location.
 3. Direct the evacuation of the floor in accordance with directions received and the following guidelines:
 - (a) The Fire Warden shall select the Exit/Stairs furthest away from the fire to use, on the basis of the location of the fire and any information received. If Exit/Stairs is affected by smoke, an alternate Exit/Stairs shall be selected. If fire conditions do pose a personal threat, The Fire Warden should activate the fire alarm pull station and evacuate to a safe location.
 - (b) The priority floors for immediate evacuation are the fire floor, one floor above and one floor below the fire. Evacuation from other floors shall be instituted when conditions indicate such action or when instructed by the Fire Department or the Fire Safety Director. Evacuation should be via uncontaminated Exit/Stairs. In the event of a fire alarm only, the minimum procedures are to prepare to evacuate by relocating occupants to the nearest Exit/Stair door.

- (c) Relocation and reentry into the building at least 3 or more floors below the fire floor is generally adequate.
- (d) Fire Wardens on the fire floor shall, as soon as practical, notify the Fire Safety Director of the conditions on that floor.
- (e) Mobility-Impaired occupants may require special assistance in the event of a fire. Occupants not requiring assistance should evacuate first. This avoids the possibility of persons in need of assistance being bumped and/or falling down, thus slowing evacuation and/or causing injury. If there is evidence of fire, the person having mobility impairments should be positioned near the Exit/Stair that is located farthest away from the fire. If fire conditions pose personal threat, the person having mobility impairment, Fire Warden or any other person assisting, should be positioned within the Exit/Stair and wait for the Fire Department. If fire conditions pose a personal threat in the Exit/Stairs, the mobility-impaired person should be evacuated to a safe location. If the mobility impaired person enters the Exit/Stairs, someone should notify the Fire Department of their location in the Exit/Stairs and that the mobility impaired person requires special assistance with evacuating.

NOTICE TO ALL FIRE WARDENS - It is your responsibility to inform the Fire Safety Director in the event of vacation, leave of absence, transfer, sickness, etc., in order to make necessary provisions regarding replacements or substitutes.

GENERAL DUTIES

I. All owners, managers and tenants of high-rise buildings shall comply with all applicable provisions of the City of Houston Fire and Construction Codes.

II. Fire Safety Team. A Fire Safety Team is hereby defined as the Fire Safety Director, Assistant Directors, the Building Emergency Response Personnel (BERP), and such other persons specified in the approved plan. The members of the Fire Safety Team shall possess a certificate signed by persons, institutions, or companies approved by the Fire Marshal to do certification training.

- A. The training required for a certificate shall include organizing and training to conduct fire drills, evacuations and related activities. Such training shall be approved by the Fire Marshal and may include a written test and demonstrations of individual proficiency.
- B. Required training for certification shall be done by persons, institutions or companies approved by the Fire Marshal according to regulations established by the Fire Marshal.
- C. Certificates shall be valid for a period of 5 years from the date of training.

III. Fire Safety Plan of Procedure for Evacuation. Submission; Implementation.

- A. The process to receive an approved Fire Safety Plan consists of the 3 following essential training elements conducted by persons, institutions or companies approved by the Fire Marshal according to regulations established by the Fire Marshal:

1. Consultation with building's upper management,
 2. High-rise Certification Training class, and
 3. A fire drill supervised by persons, institutions or companies approved by the Fire Marshal.
- B. The owner, management or designated representative of a high-rise building shall possess and maintain only the standard City of Houston, Texas, Fire Safety Plan, approved by the Fire Marshal according to regulations established by the Fire Marshal. The emergency plan shall include the following:
1. Identify the responsible person designated as the "Fire Safety Director" and their duties.
 2. List of sufficient alternates shall be provided for each Fire Safety Director and Assistant Directors.
 3. Provide approved procedures for reporting all unwanted fires and/or fire alarms.
 4. Narrative on the Fire Alarm system.
 5. Procedures for evacuation.
 6. Identify the building fire safety features.
 7. Maps with means of egress. A means of egress comprises the vertical and horizontal ways of travel to a public way.
 - a) The maps shall also indicate those Exit/stair doors through which, under emergency conditions, exit and re-entry may be made.
 - b) The locations of all of the following components shall be required on the maps:
 1. Fire Alarm Pull Stations
 2. Fire Extinguishers and Fire Hose Cabinets
 3. Elevator Lobbies
 4. Exit/Stairs Identification
 5. Re-entry floors

RESPONSIBILITIES

I. The Fire Safety Director shall:

- A. Maintain current Fire Safety Team training records. Records shall be made available to the Fire Marshal upon request.
- B. Notify an on-site management representative who shall be the Acting Fire Safety Director and be capable of directing an evacuation as provided for in the Fire Safety Plan when the Fire Safety Director is not available in the building. The training and related activities of the Acting Fire Safety Director shall be under the direction of the Fire Safety Director. Such activities shall be subject to Fire Department control.
- C. Distribute the approved Fire Safety Plan to all tenants, Fire Wardens and building management employees who are staff and/or contracted personnel.
- D. Be familiar with the approved Fire Safety Plan, and conduct a fire drill at least every 6 months. The Fire Marshal, upon survey of conditions, may require additional drills. A written record of such drills shall be kept on the premises and shall be readily available for Fire Department inspection.
- E. Select, organize, train and supervise qualified Building Emergency Response Personnel and be responsible for their availability and state of readiness.
- F. Implement an approved training program to provide fire prevention and emergency procedures for all building management employees who are staff and/or contracted personnel.
 - ♦ Ensure that each employee be familiar with the Fire Safety Plan, the location of Exit/Stairs and the location and activation of any available fire alarm pull stations.
- G. Be responsible for installation and maintenance of the Fire Depository Box and its contents, including Mobility Impaired Lists. (See Houston Fire Department LSB Standard No. 06, "Fire Depository Boxes")
- H. Provide facilities and assistance as needed by the Fire Marshal to obtain approval for the Fire Safety Plan.
- I. The building manager or owner of a high-rise office building, who has employed or contracted with an answering service, shall provide instructions to the answering service located within the City of Houston/Harris County "9-1-1" service area to call **9-1-1** when any unwanted fire, the smell of smoke, or a fire alarm is reported to them.

Answering services outside of the City of Houston/Harris County "9-1-1" service area shall call the Houston Fire Department Office of Emergency Communications telephone number: **713-884-3143**.

Answering services shall instruct the caller that, from a safe place, to dial **9-1-1**, to report the fire conditions to the Fire Department as well.

- J. Notify the tenant when any employee of the tenant or individual is neglecting their responsibilities stated in the Fire Safety Plan. If the tenant fails to correct the condition, the owner or person in charge of the building shall notify the Fire Marshal.
- K. Understand the purpose and operation of all fire- and life-safety systems located in the building under the control of the building owner or manager.

II. Answering Service

- A. Answering services within the City of Houston/Harris County "9-1-1" service area shall notify the Fire Department by calling **9-1-1** when any unwanted fire, or sight or smell of smoke, or flames, and/or hear any fire alarm is reported.
- B. Answering services outside of the City of Houston/Harris County "9-1-1" service area shall call the Houston Fire Department Office of Emergency Communications telephone number, **713-884-3143**. Answering services shall instruct the caller who is reporting any unwanted fire, or sight or smell of smoke, or flames, and/or hear any fire alarm, to dial **9-1-1** from a safe location to report the conditions to the Fire Department as well.

III. Fire Wardens

- A. Each floor of a building shall be under the direction of the certified Fire Wardens for the evacuation of occupants when it can be done safely in the event of a fire and/or fire alarm.
- B. Each Fire Warden shall be familiar with the Fire Marshal approved Fire Safety Plan, the location of Exit/Stairs and the location and operation of any available fire alarm systems.

IV. Building Emergency Response Personnel

- A. Shall be trained in accordance with regulations established by the Fire Marshal.
- B. Duties and responsibilities shall be in accordance with regulations established by the Fire Marshal.
- C. Shall be familiar with the Fire Safety Plan, the location of Exit/Stairs and the location and activation of any available fire alarm systems.

V. Tenants

- A. Each tenant shall be required to comply with the Fire Marshal approved Fire Safety Plan.
- B. Upon the request of the building owner, manager or designated representative, the tenants shall provide certified Fire Wardens. Tenants shall make responsible and dependable employees available for high-rise certification training towards approval and implementation of the Fire Safety Plan.
 - 1. A certified Fire Warden shall be provided for each tenancy per floor. When the floor area of a tenancy exceeds 7,500 square feet of occupiable space, a certified Warden shall be assigned for each such 7,500 square feet or part thereof.

2. Each floor of a building shall have a minimum of 2 certified Fire Wardens, even if there less than 7,500 sq. ft occupied on the floor.
- C. The Fire Marshal approved Fire Safety Plan shall be distributed by the tenants to all their employees.
- D. Advise the Fire Safety Director of any employees that may wish to have special assistance in evacuation so that the building's Mobility-Impaired List can be updated in the building's Fire Depository Box.

FIRE DRILLS

- I. A fire drill shall be conducted at least every 6 months.
- II. All occupants shall be notified prior to the fire drill.
- III. All occupants of the building shall participate in the fire drill as required by the Fire Marshal.
- IV. The Fire Marshal, upon survey of conditions, may require additional drills.
- V. A written record of such drills shall be kept on the premises and shall be readily available for Fire Department inspection.

SPECIAL INSTRUCTIONS - ASSISTING THE MOBILITY IMPAIRED

Persons having any mobility impairment need to be considered prior to any need for evacuation. It is necessary for tenants and mobility-impaired persons to notify the Fire Safety Director of any mobility-impaired person that may wish to have special assistance in the event of an evacuation. A list must be maintained and updated at least every 6 months or as necessary.

Mobility-Impaired occupants may require special assistance in the event of a fire. Occupants not requiring assistance should evacuate first. This avoids the possibility of persons in need of assistance being bumped and/or falling down, thus slowing evacuation and/or causing injury. If there is evidence of fire, the person having mobility impairments should be positioned near the Exit/Stair that is located farthest away from the fire. If fire conditions pose personal threat, the person having mobility impairment, Fire Warden or any other person assisting, should be positioned within the Exit/Stair and wait for the Fire Department. If fire conditions pose a personal threat in the Exit/Stairs, the mobility-impaired person should be evacuated to a safe location. If the mobility impaired person enters the Exit/Stairs, someone should notify the Fire Department of their location in the Exit/Stairs and that the mobility impaired person requires special assistance with evacuating.

PUBLIC ADDRESS ANNOUNCEMENTS

- I. IN CASE OF **FIRE ALARM**, RECITE THE FOLLOWING TO THE FLOOR OF ALARM, THE FLOOR ABOVE, AND THE FLOOR BELOW:

“This is the Building Management, we have an alarm on # ____ floor.

The Fire Department has been notified.

Floors ____, ____, and ____ please prepare to evacuate by going to the Exit/Stair door, if there is any evidence of fire, please evacuate the floor to a safe area.”

- II. IN CASE OF **FIRE**, RECITE THE FOLLOWING TO THE FLOOR OF INCIDENT, THE FLOOR ABOVE, AND THE FLOOR BELOW:

“This is the Building Management; we have an emergency on # ____ floor.

The Fire Department has been notified.

Floors ____, ____, and ____ evacuate the floor to a safe area using the Exit/Stairs.”

NOTE: The Fire Safety Director and/or the Fire Department will make additional announcements as conditions warrant.

FIRE ALARM RECORDING

- I. **English Version:** An alarm has been reported. Please prepare to evacuate by going to the Exit/Stair door. If there is any evidence of fire, evacuate the floor using the Exit/Stairs to a safe area.
- II. **Spanish Version:** Se ha reportado una alarma. Por favor, prepárense para evacuar yendo a la salida de emergencia o la puerta de las escaleras. Si hay cualquier evidencia de fuego, evacuen el piso a un lugar seguro.

APPENDIX I

FIRE ALARM SYSTEM OPERATIONS

The following is a narrative of the fire alarm system and its method of operation.

- I. What automatic building features are initiated when:
 - A. One smoke detector in the corridor is activated?
*Alarm sounds on the floor of incident. Also, on floor above and below incident.
Air handlers shut down on floors in alarm.
Stairwell pressurization activates only in stairwell B*
 - B. Second smoke detector is activated in the corridor?
*Alarm sounds on the floor of incident. Also, on floor above and below incident.
Air handlers shut down on floors in alarm.*
 - C. One smoke detector is activated in the elevator lobby?
*Alarm sounds on the floor of incident. Also, on floor above and below incident.
Air handlers shut down on floors in alarm.*
 - D. Second smoke detector is activated in the elevator lobby?
*Alarm sounds on the floor of incident. Also, on floor above and below incident.
Air handlers shut down on floors in alarm and the elevators recall to ground floor.*
 - E. A fire alarm pull station is activated on an above the ground floor?
*Alarm sounds on the floor of incident. Also, on floor above and below incident.
Air handlers shut down on floors in alarm.*
 - F. A fire alarm pull station is activated on the ground floor?
*Alarm sounds on the floor of incident. Also, on floor above and below incident.
Air handlers shut down on floors in alarm.*
 - G. How do you activate a general alarm (alarm tone audible on all floors)?
Activate Full Building Alarm by Pull Station in Fire Command Center.

APPENDIX II

BUILDING SAFETY FEATURES

FIRE COMMAND CENTER -	Edwards System Technology (EST3) panel located on ground floor.
COMMUNICATIONS/PA -	PA Systems through Edwards System Technology (EST3) panel.
STAIRWELLS -	Speakers only. The two stairwells are equipped with P.A. speakers only.
CORRIDORS -	Pull stations, smoke detectors and speakers.
ELECTRONIC LOCKS -	Release on fire alarm.
ELEVATORS -	Recalls to ground level. If ground level is in alarm, the elevators recall to the second floor.
HEATING, VENTILATION AND AIR CONDITIONING -	Air handlers shut down on floors in alarm.
SPRINKLER SYSTEM / STANDPIPE - Building 100% sprinkled.	Standpipe riser in both stairwell A and B.
EXTINGUISHING SYSTEMS -	Five-pound extinguishers in all fire hose cabinets at stairwell A and B.
EMERGENCY GENERATOR -	Activates all elevators, emergency lighting, strobes, PA system, speakers and pull station

APPENDIX III

ELEVATOR EMERGENCY FIRE SERVICE OPERATION

A. Phase I (Elevator Fire Service Recall)

- ♦ **Key Off:**
Normal elevator operation
- ♦ **Key On:**
Recalls elevator to designated recall floor
- ♦ **Key By-Pass or Reset**
Overrides heat and smoke sensors to allow normal operation

** Specify manual recall procedures. * If doors close after being recalled, specify how to re-open.

B. Phase II (Elevator Fire Service to Car Operations)

To operate car:

Insert fire key and turn to "ON"

To travel to desired floor:

Press desired button

To close door:

Press and hold "DOOR CLOSE" button

To open door:

Press and hold "DOOR OPEN" button

To hold car at floor:

With doors open, turn key to "HOLD"

To cancel floor selection:

Press "CALL CANCEL" button

To return car to designated or alternate landing:

**PROVIDE INSTRUCTIONS FOR EACH (DIFFERENT) BANK OF ELEVATORS THAT MAY
OPERATE INDEPENDENTLY FROM ANOTHER.**

APPENDIX IV

BROOKHOLLOW II - CERTIFIED FIRE WARDENS

PARKING GARAGE

Parking Office

Jimmy Herrera

Date Certified

July 2011

BASEMENT

Engineering Office

Aldo Acosta

Randy Burleson

Carlos Gonzalez

Joe Alcantar

April 25, 2011

March 28, 2011

March 25, 2011

March 28, 2011

Security

Jose Martinez

Krystal Wolford

Reginald Paige, Jr.

Charles Baker

La'keytheia Thurman

April 24, 2012

March 15, 2012

November 24, 2008

November 1, 2010

May 1, 2010

FLOOR 1

Date Certified

VACANT

FLOOR 2

VACANT

FLOOR 3

VACANT

FLOOR 4

VACANT

FLOOR 5

VACANT

FLOOR 6

VACANT

FLOOR 7

VACANT

FLOOR 8

VACANT

FLOOR 9

VACANT

FLOOR 10

VACANT

FLOOR 11

WOOD GROUP POWER SOLUTIONS

Jeanice Brown Harmon
Lisa M. Fernandez

May 6, 2018
April 8, 2018

FLOOR 12

WOOD GROUP POWER SOLUTIONS


Kimberly Williams
Angela Beard
Caroline Price

July 25, 2017
November 29, 2016
November 29, 2016


APPENDIX V


MAPS

BROOKHOLLOW CENTRAL I

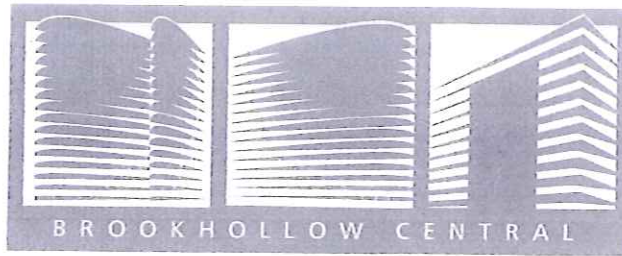

BROOKHOLLOW CENTRAL I
Suite 200
16,780 SF

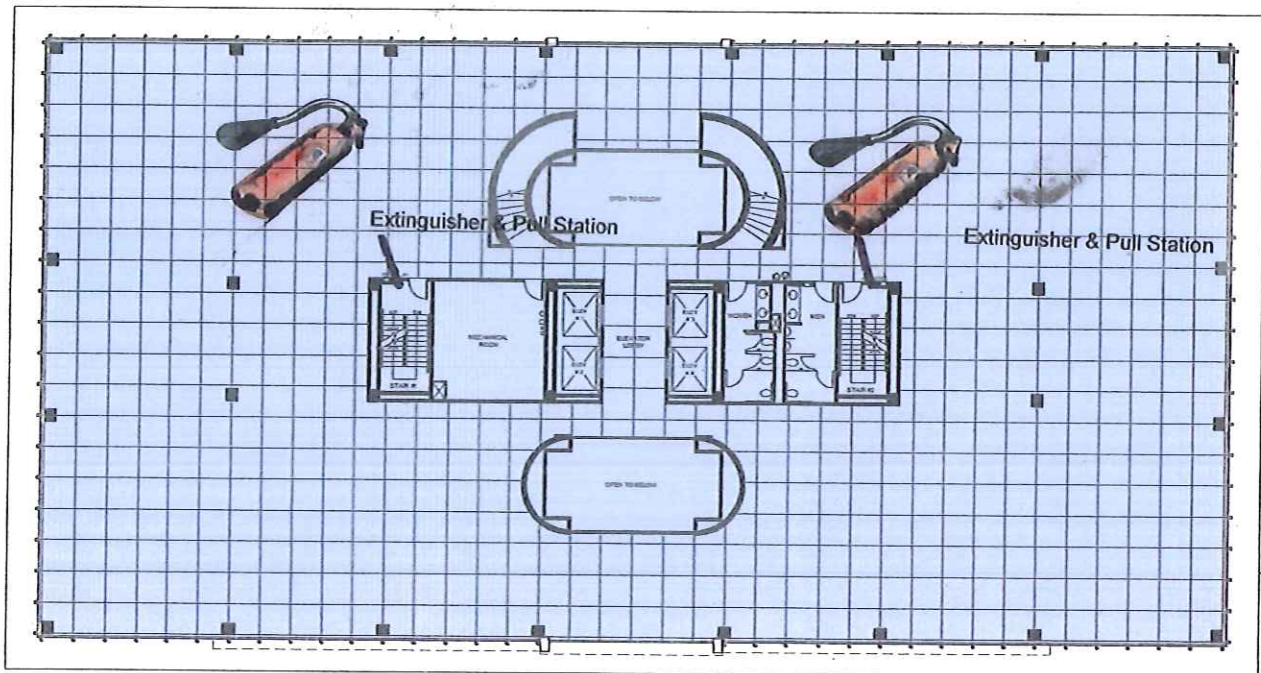


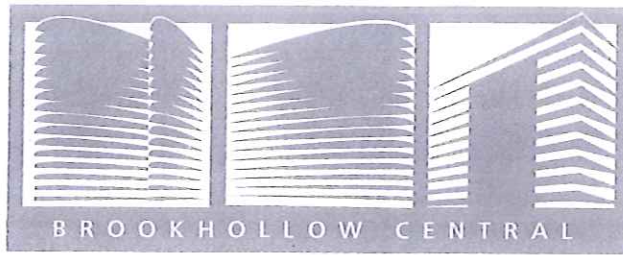


BROOKHOLLOW CENTRAL I


Suite 100

3,054 SF

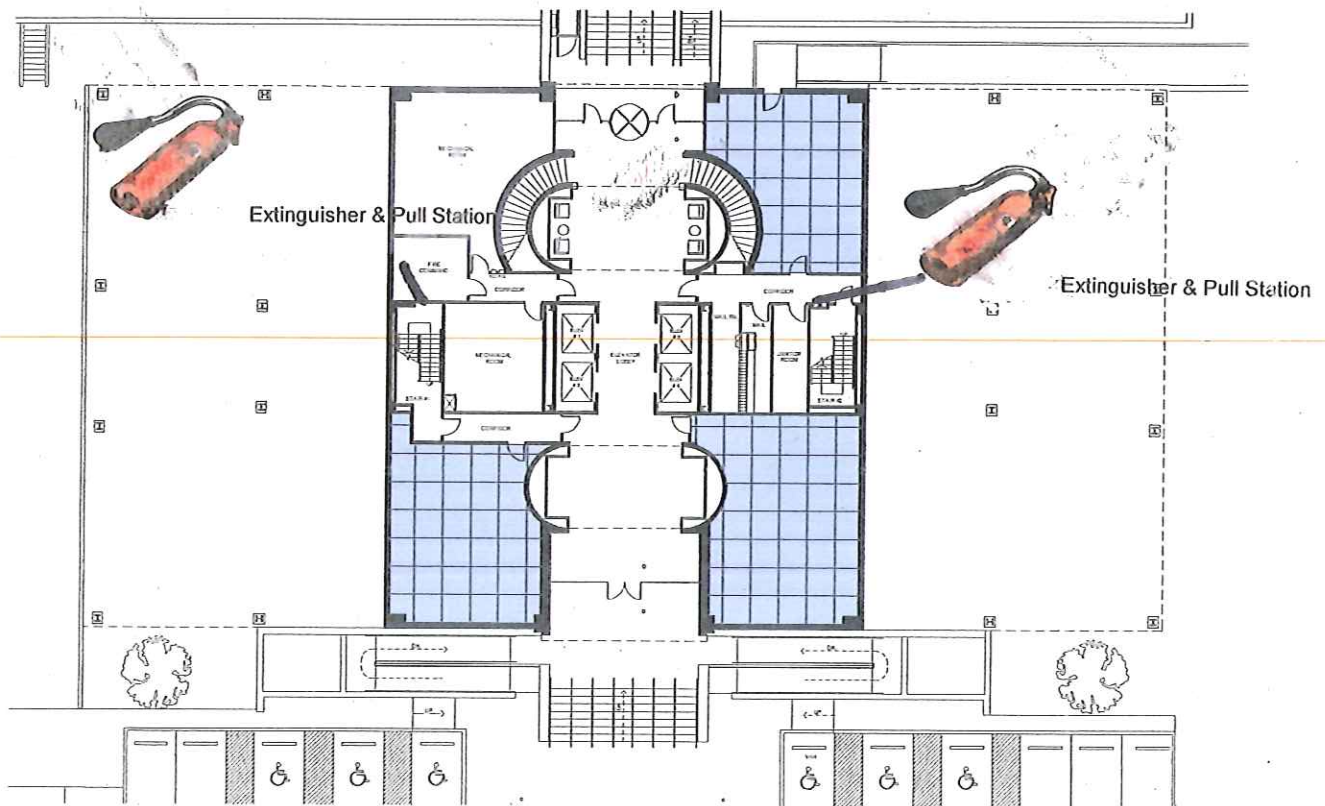

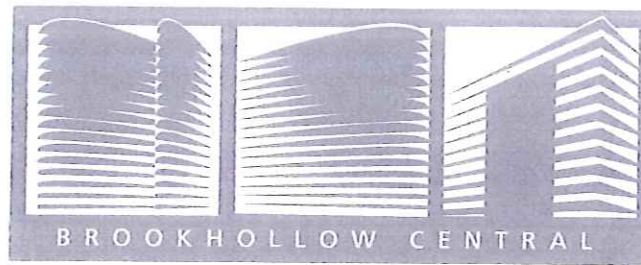


BROOKHOLLOW CENTRAL I
Suite 300
18,170 SF

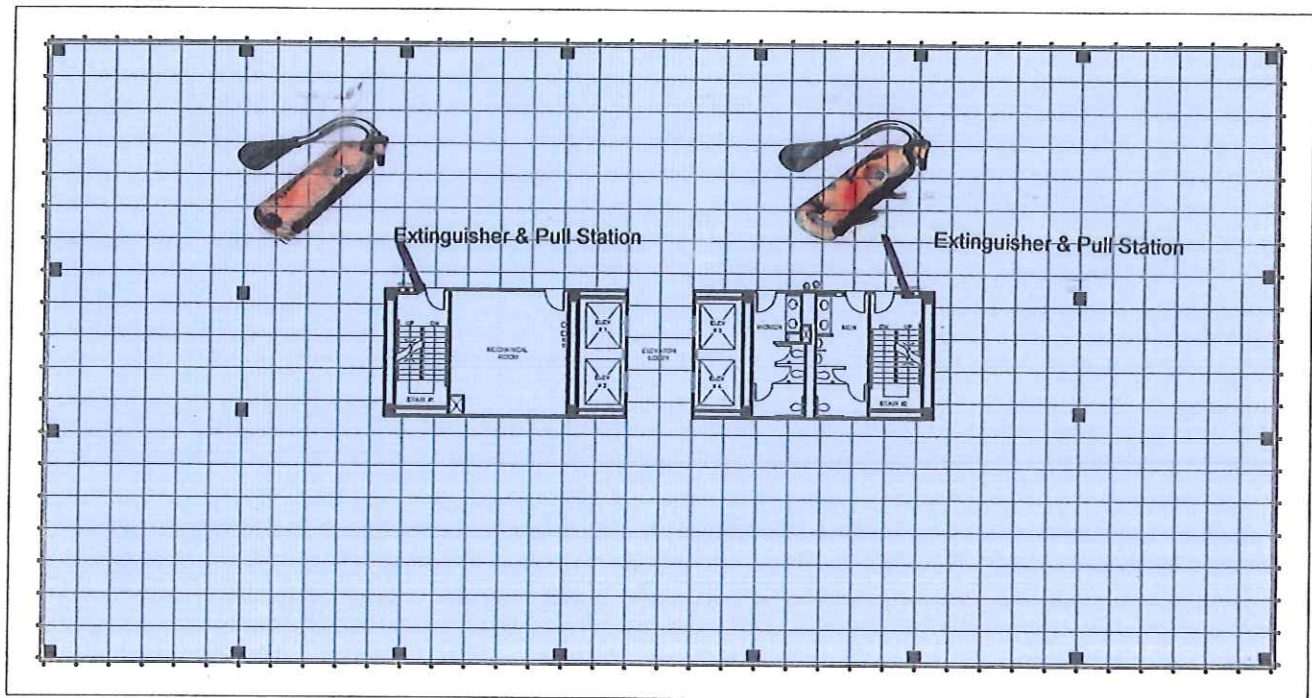


PARMENTER REALTY PARTNERS


For leasing information, please contact:
Colvill Office Properties 713.877.1550 leasing@colvilloffice.com
www.colvilloffice.com



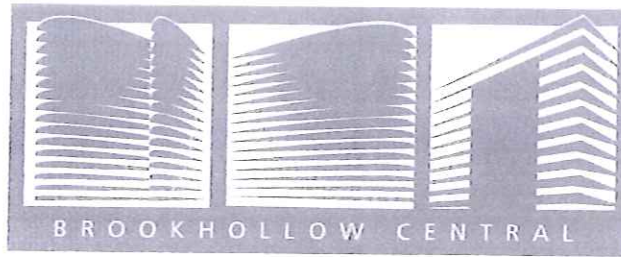



BROOKHOLLOW CENTRAL I
Suite 400
18,170 SF

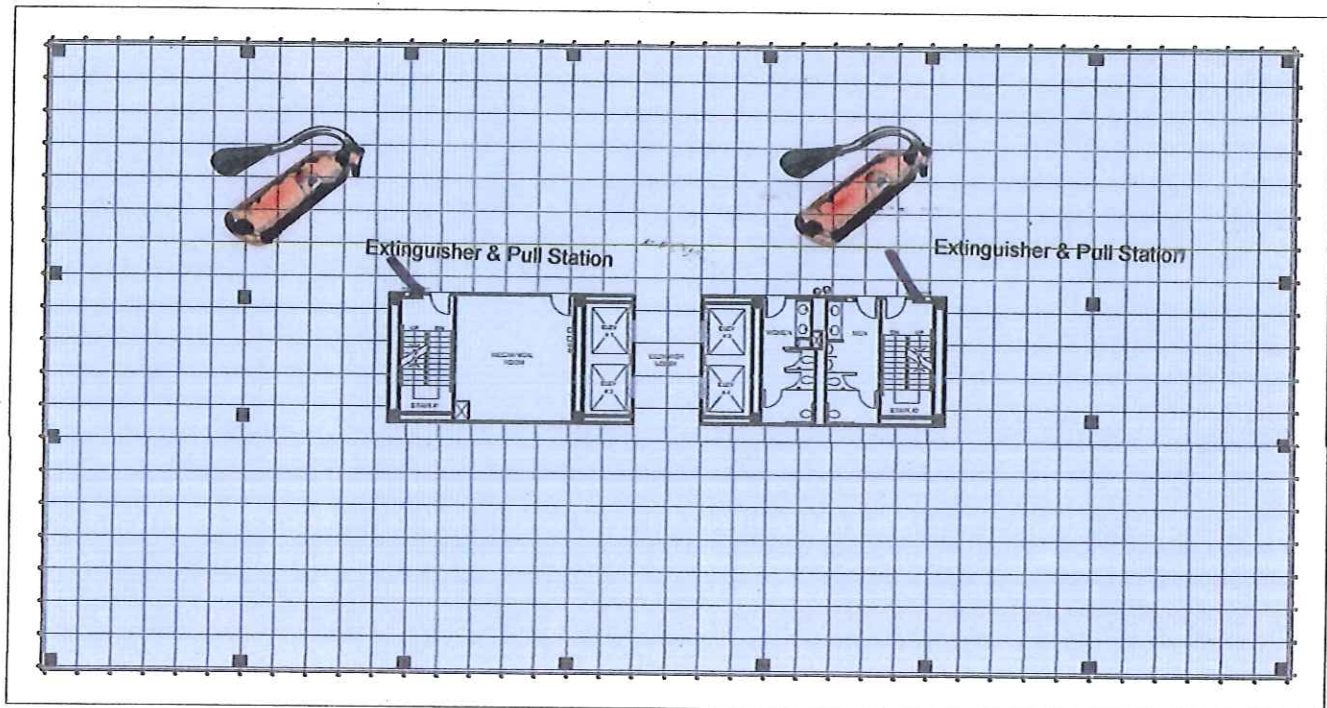

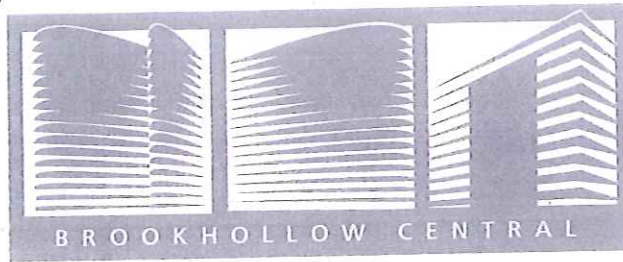



BROOKHOLLOW CENTRAL I
 Suite 500
 18,170 SF

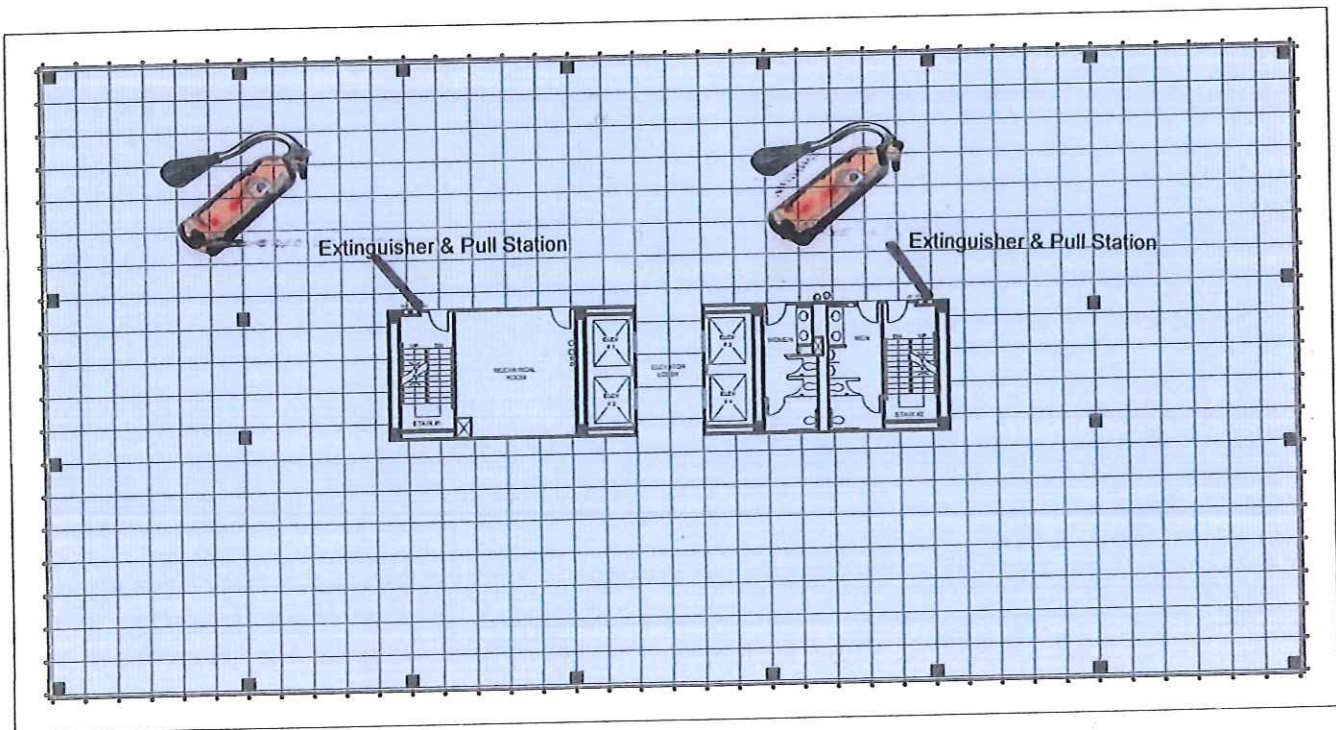

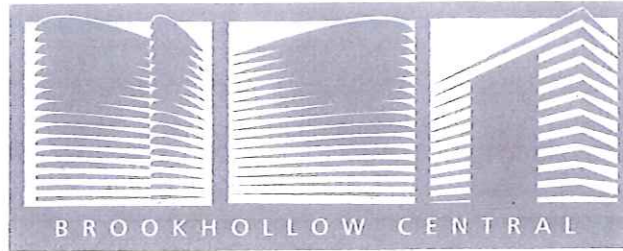


BROOKHOLLOW CENTRAL I
Suite 600
18,170 SF

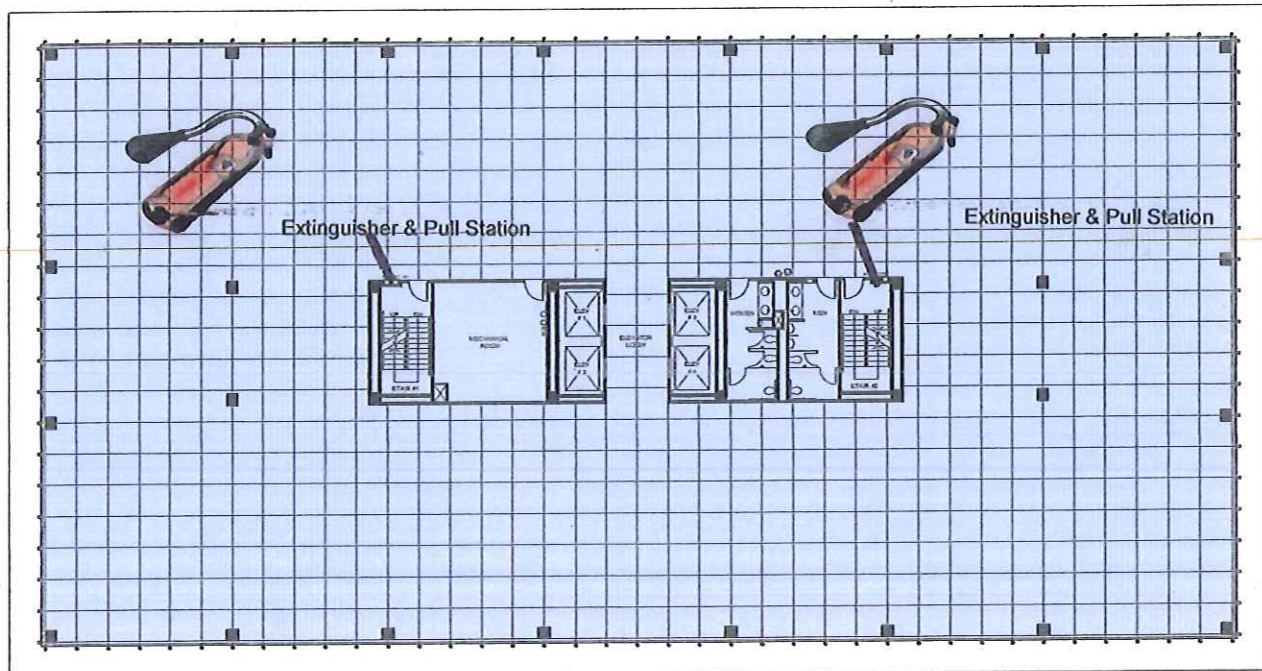


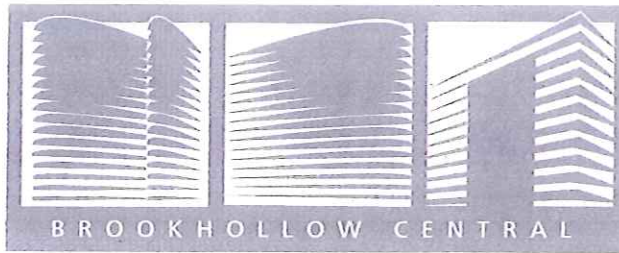


BROOKHOLLOW CENTRAL I

Suite 700
18,170 SF

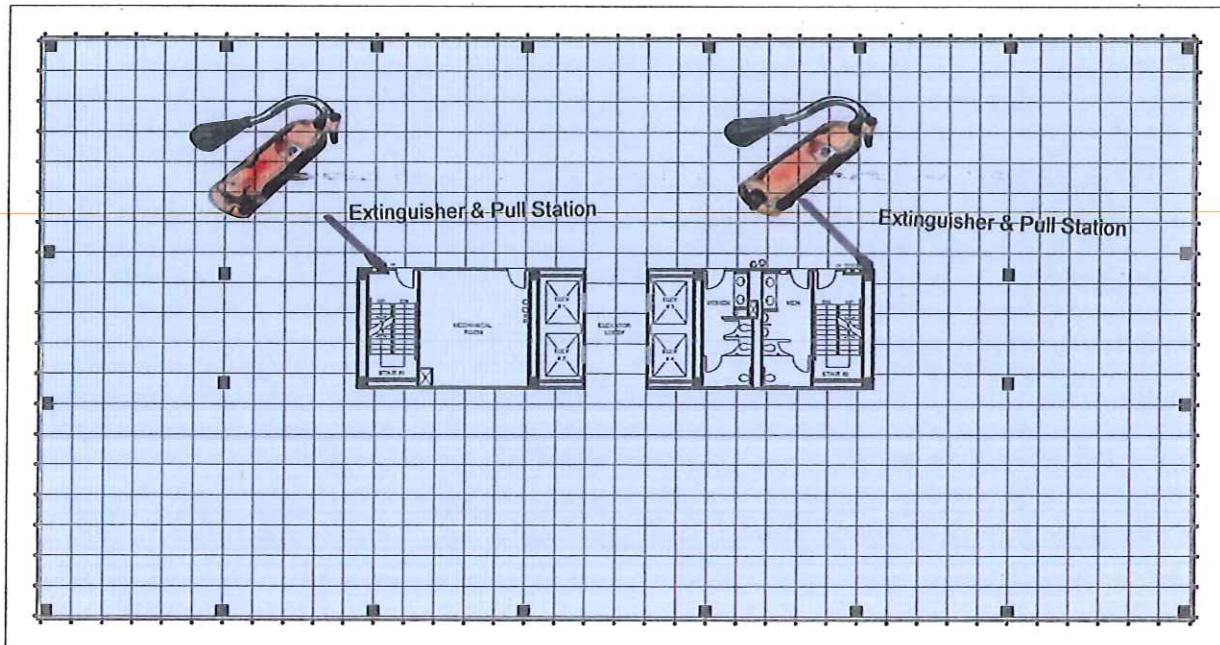


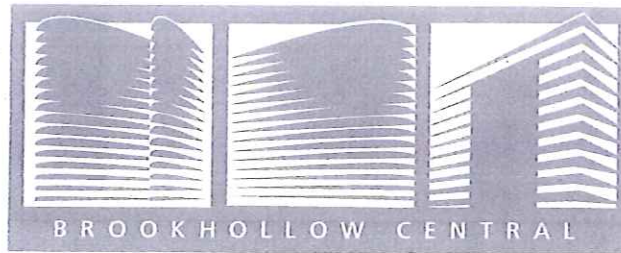

BROOKHOLLOW CENTRAL I
Suite 800
18,170 SF

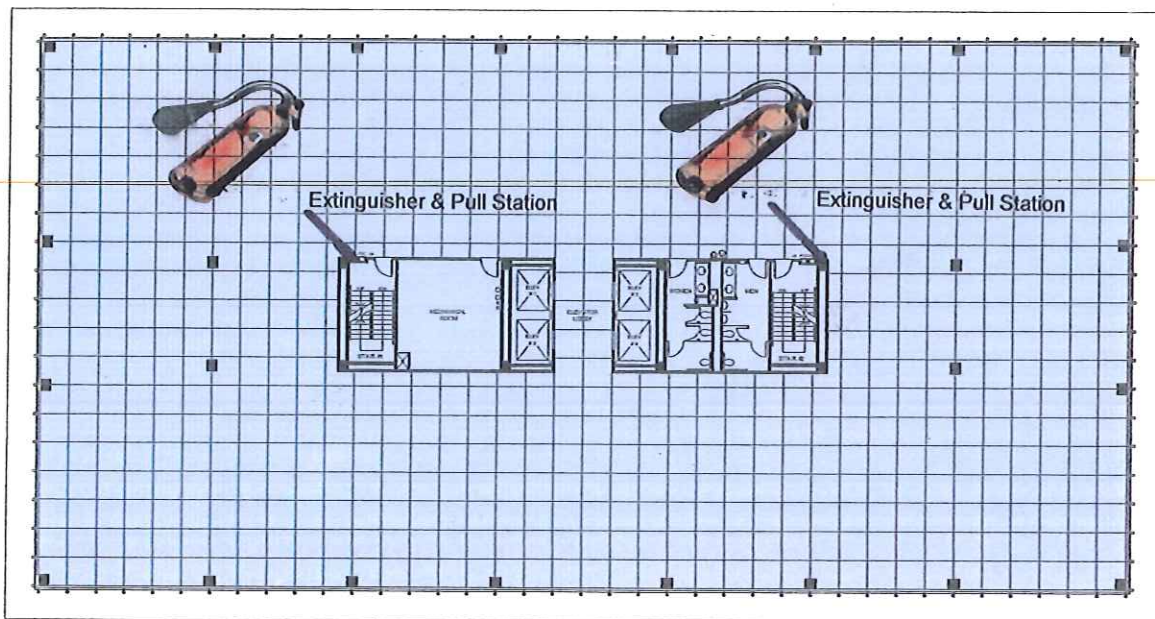

VACANT
SUITE 920
7,506 RSF

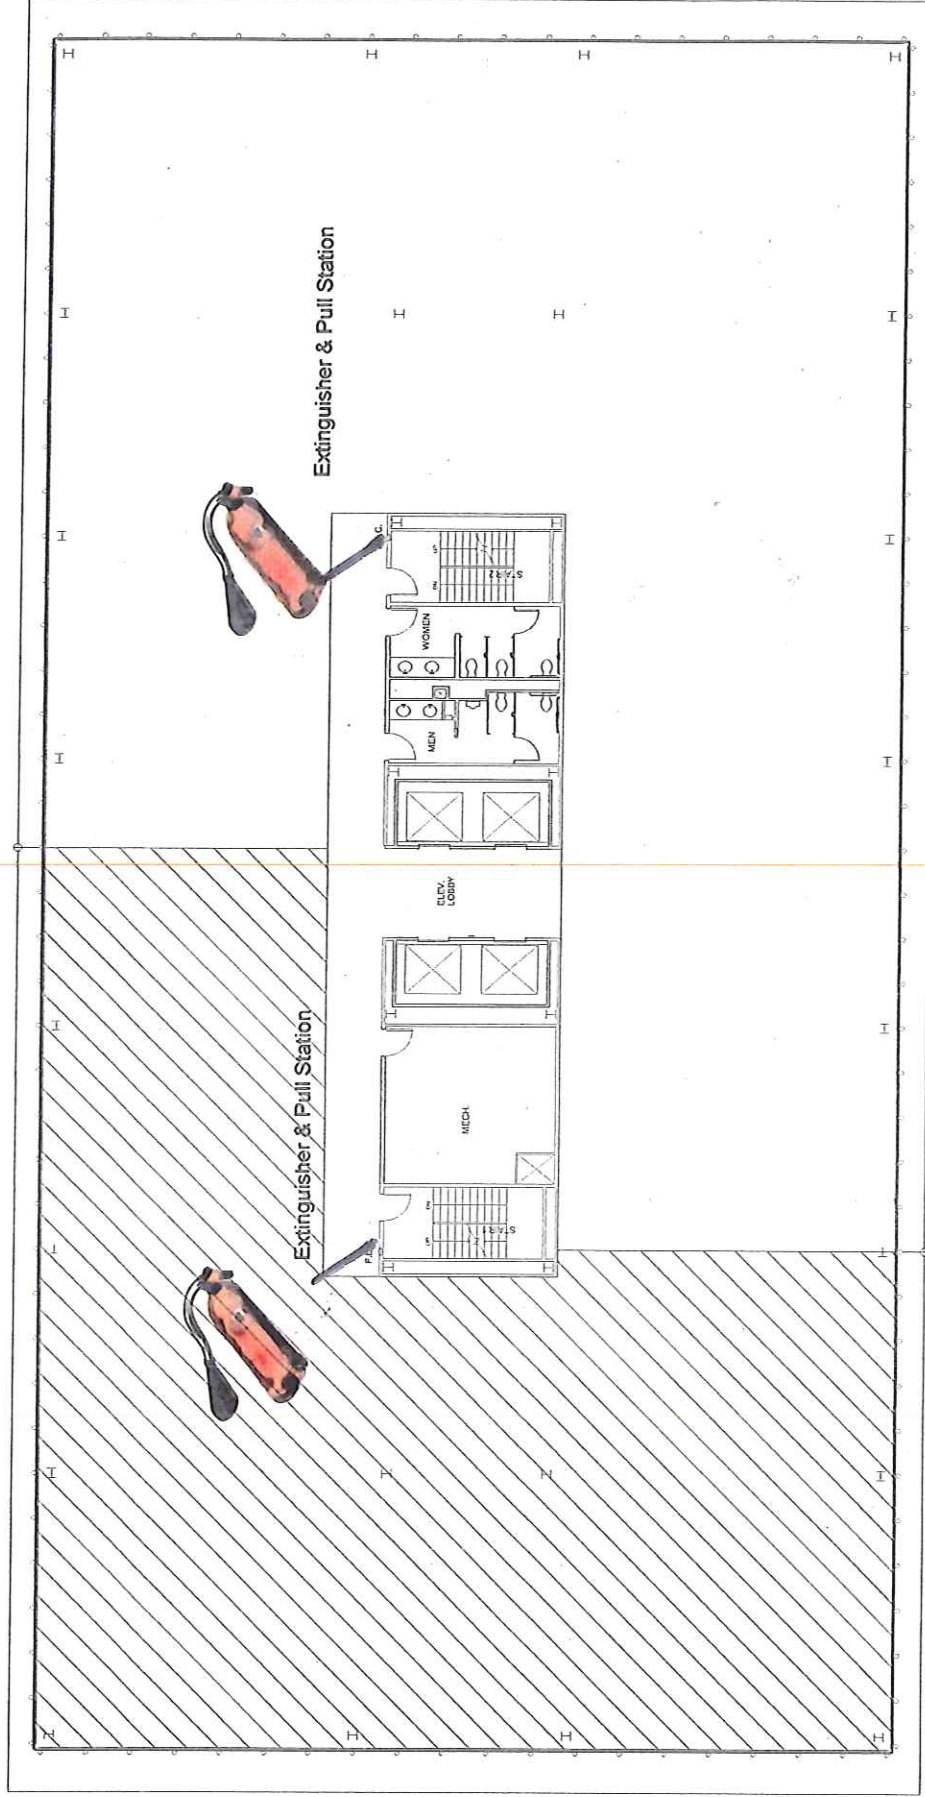

BRAEMAR TECHNICAL SERVICES
SUITE 900
10,664 RSF


BROOKHOLLOW CENTRAL I

2800 North Loop West, Houston, Texas 77092


EXHIBIT




MAY 2014

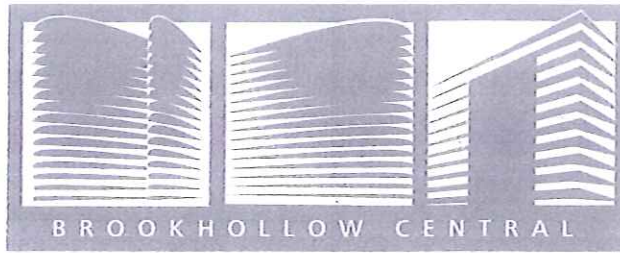

BROOKHOLLOW CENTRAL I
Suite 1000
17,999 SF

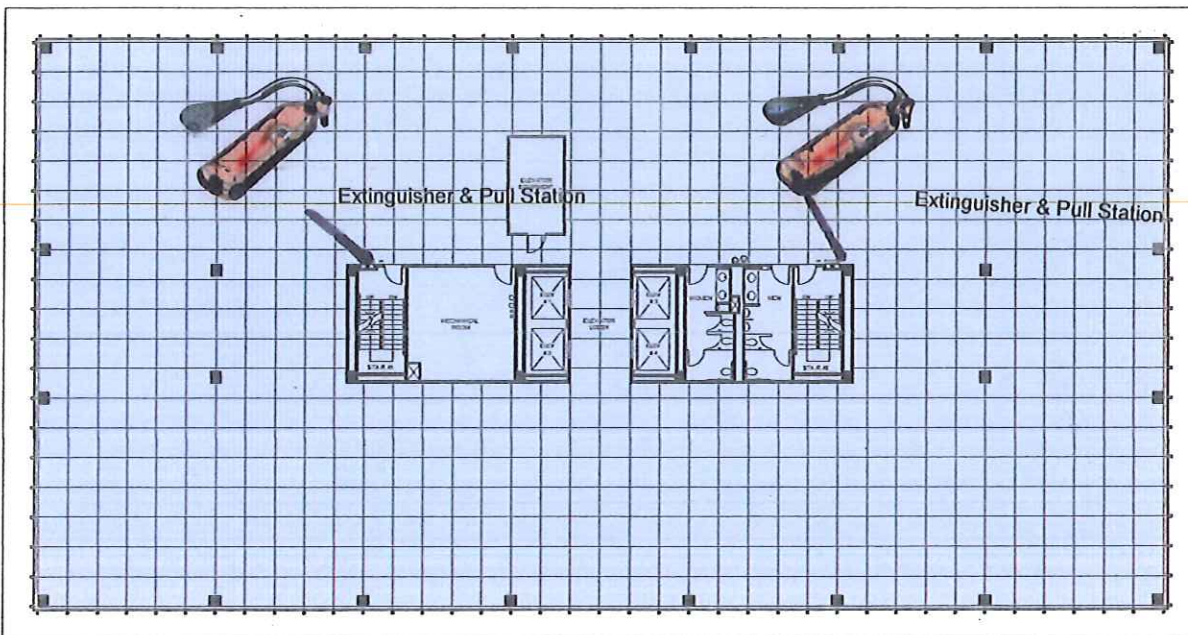

WOOD GROUP SOLUTIONS
SUITE 1100
18,238 RSF

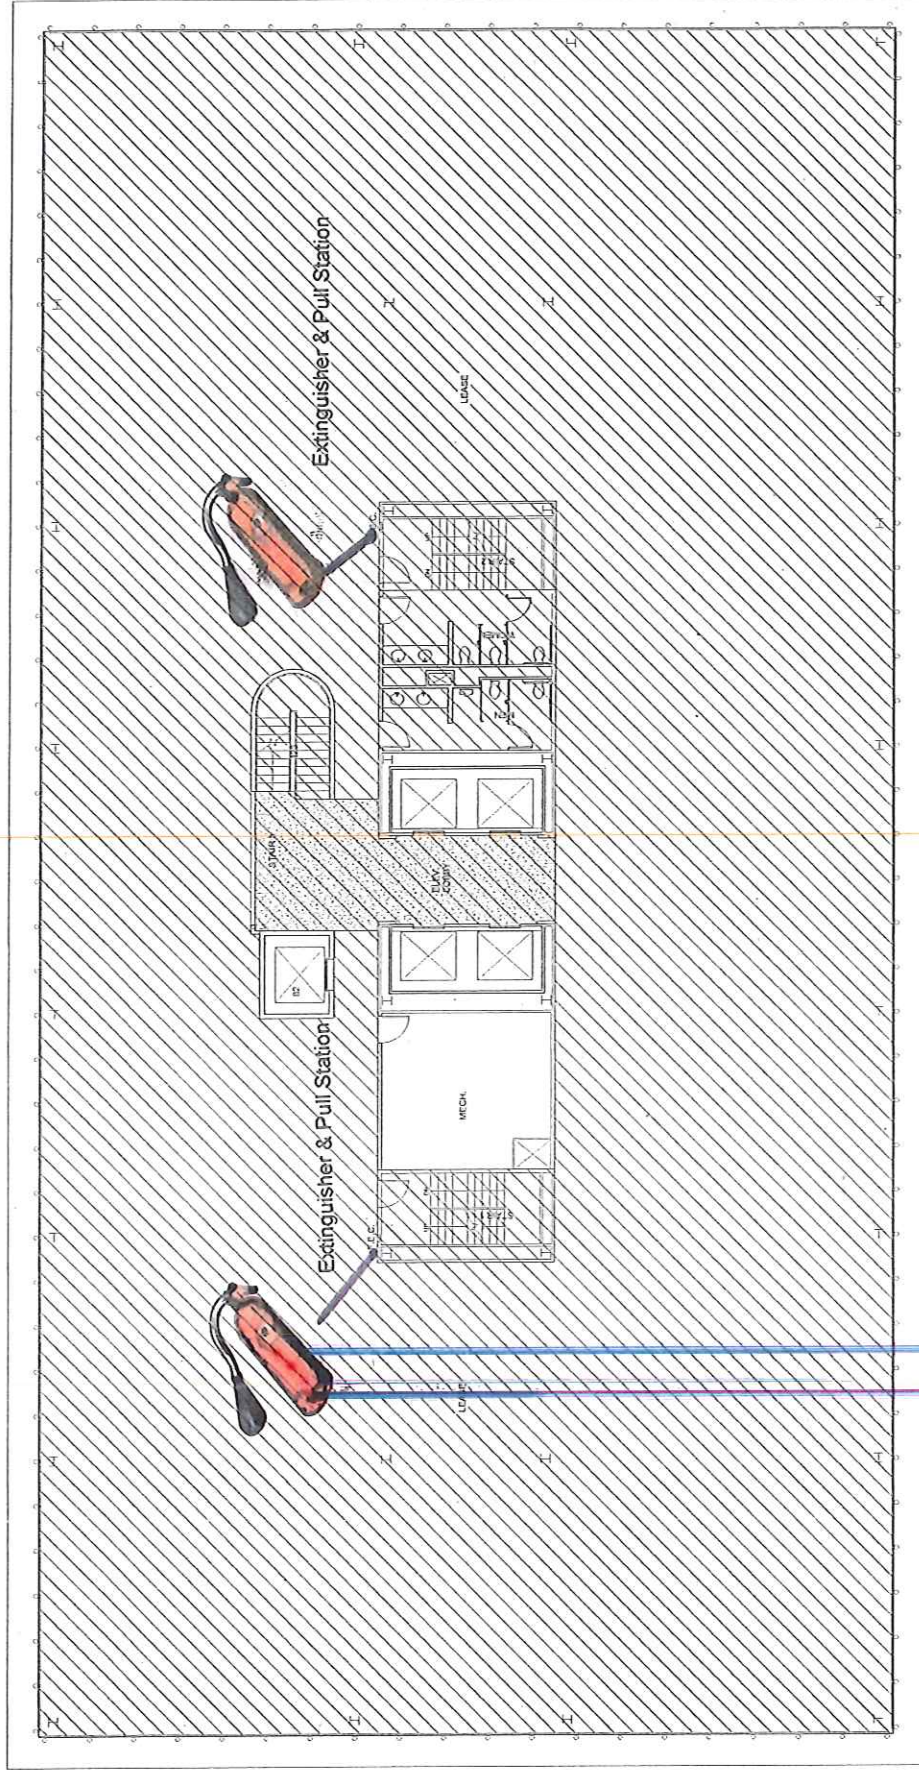


BROOKHOLLOW CENTRAL I

2800 North Loop West, Houston, Texas 77092

MAY 2014

WOOD GROUP SOLUTIONS
SUITE 1200
17,688 RSF

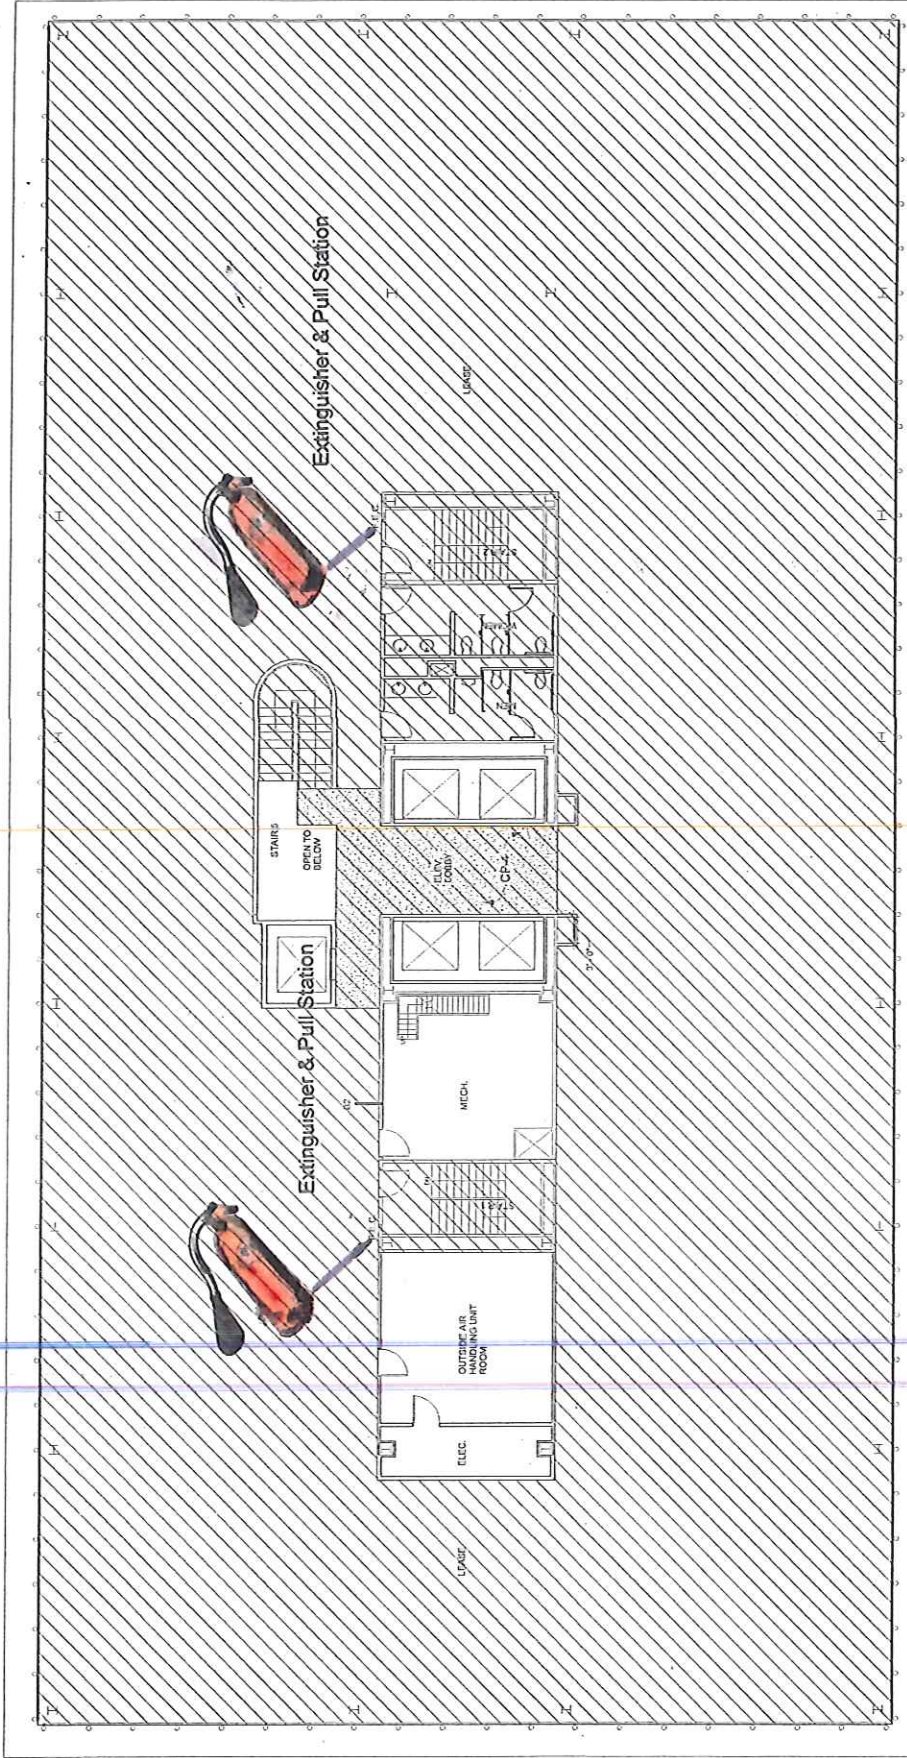

BROOKHOLLOW CENTRAL I

2800 North Loop West, Houston, Texas 77092



MAY 2014